

NOTES: UNLESS OTHERWISE SPECIFIED

1. MATERIALS AND COMPONENTS ARE RoHS/REACH COMPLIANT.
2. CONNECTORS MEET THE REQUIREMENTS OF ANSI/TIA 568-C.3
3. 100% TESTED FOR OPTICAL PERFORMANCE, END FACE CRITERIA AND CLEANLINESS.
4. CABLE ASSEMBLIES ARE MANUFACTURED TO C ENTERPRISES STANDARDS.
5. STANDARDS AND SPECIFICATIONS AVAILABLE UPON REQUEST.
6. STAGGERS DEPICT C ENTERPRISES STANDARDS (DEFAULT). CUSTOM STAGGERS AVAILABLE UPON REQUEST.
7. DEFAULT BREAKOUT LENGTH IS 24 INCHES.

8. STAGGERED CONNECTORS




- 8.1. DISCRETE CONNECTORS STAGGER IN PAIRS. MT-STYLE CONNECTORS STAGGER INDIVIDUALLY.
- 8.2. CONNECTORS STAGGER IN 1 INCH INCREMENTS.
- 8.3. STAGGER ALTERNATES BY INCREASING AND DECREASING FROM DEFINED BREAKOUT LENGTH.
- 8.4. MINIMUM FIBER LEG LENGTH ON STAGGERED BREAKOUT IS 18 INCHES. ALL FOLLOWING STAGGERS WILL ONLY INCREASE.

9. STAGGERED SUBUNITS

- 9.1. SUBUNITS STAGGERED INCREASING BY 6 INCH INCREMENTS.
- 9.2. SHORTEST SUBUNIT IS 8 INCHES FROM SPIRAL WRAP. IF SPIRAL WRAP IS NOT USED, MEASUREMENT IS FROM CABLE JACKET.

10. HEAT SHRINK FOR STRAIN RELIEF. NOT TO BE USED AS A POINT OF DIMENSION REFERENCE.

REV	ECR	DESCRIPTION	BY	DATE	CHECKED
A	-	INITIAL RELEASE	K.T.	07/03/2017	A.J.

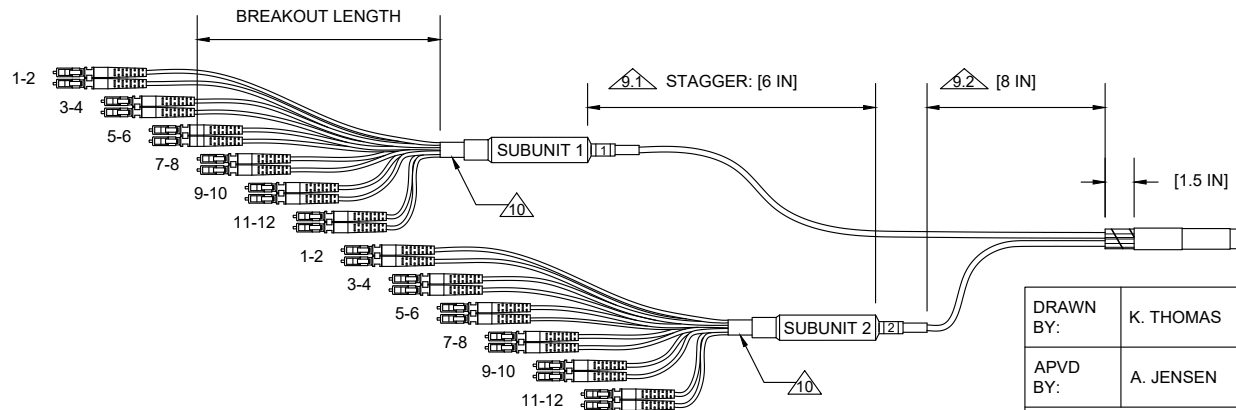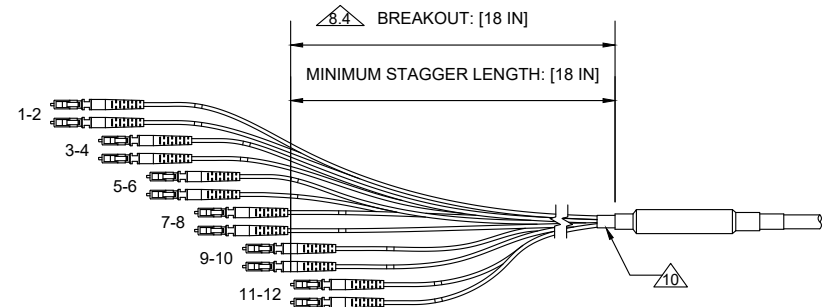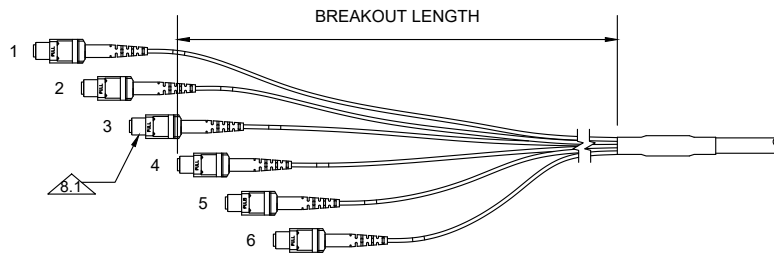

DRAWN BY:	K. THOMAS	07/03/2017
APVD BY:	A. JENSEN	07/03/2017



C ENTERPRISES
2445 CADES WAY
VISTA CA 92081
760-599-5111

DIMENSIONS: METRIC [IMPERIAL]		
PROPRIETARY AND CONFIDENTIAL		
THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF C ENTERPRISES. NOT TO BE USED, COPIED, OR DISCLOSED WITHOUT WRITTEN PERMISSION. ALL RIGHTS RESERVED.		

TITLE: STAGGERING STANDARDS		
SIZE A	DWG. NO. STAGGER	REV A
SCALE: NOT TO SCALE		SHEET 1 OF 1